


Note:
 Factory programmed to NFPA Standards
 Contact Detex Corporation for other building codes

Terminals 1-12 recommend 22 ga wire

Terminals 13-24 recommend 18 ga wire

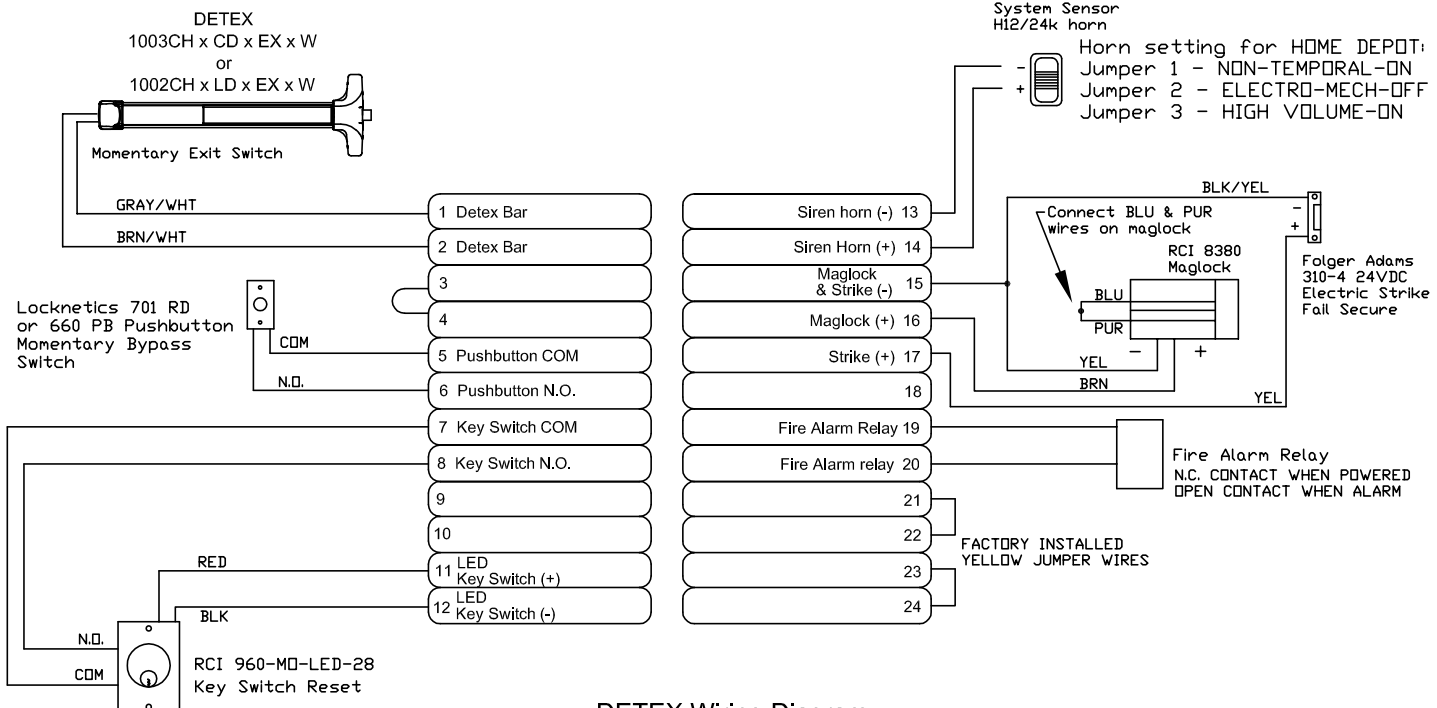

DETEX Wiring Diagram
 12-800 DE1 and 12-800 DE1LT
 15 Second Delayed Egress with Remote Bypass
 Detex 10 Series EX x W Logic Controller

DATE:	ECO#
5/2/13	Created 18294
7/8/13	19630

PART: 105751

DWG: 105751

Project: WIRING DIAGRAM
 Application: LOGIC CONTROLLER
 Supplier: PINK SHEET



1-800-729-3839

Factory Wiring

