
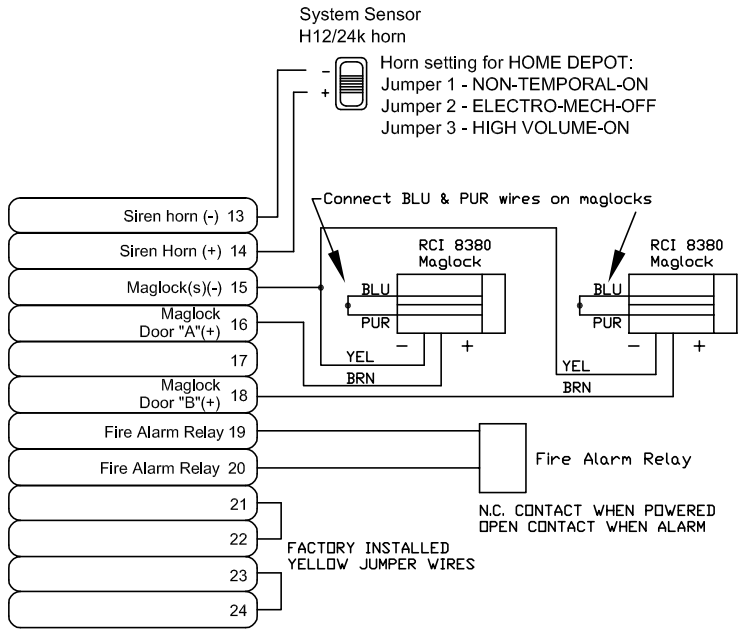


Note:
 Factory programmed to
 NFPA Standards
 Contact Detex
 Corporation for other
 building codes

Terminals 1-12 recommend 22 ga wire

Terminals 13-24 recommend 18 ga wire

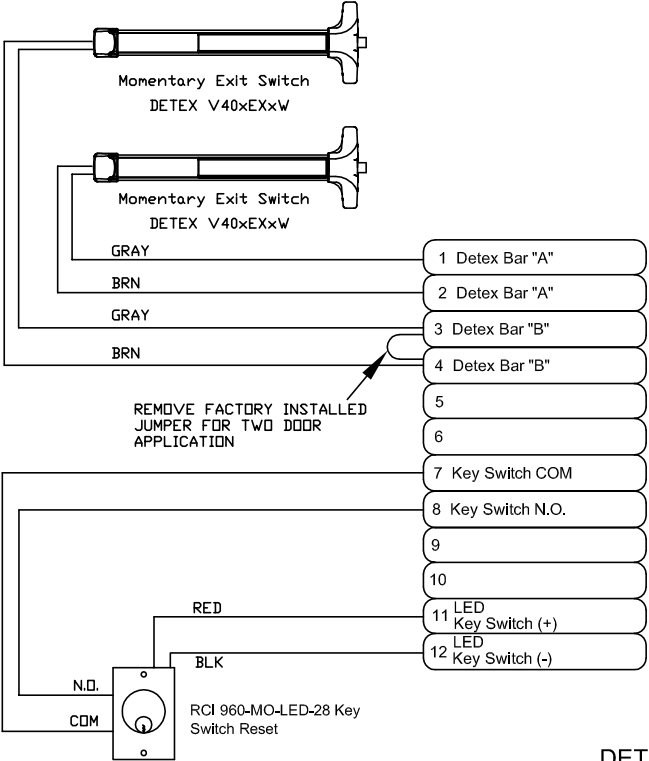

DETEX Wiring Diagram
 12-800 DE2 and 12-800 DE2LT
 15 Second Delayed Egress
 Detex V40 Series EX x W Logic Controller

DATE:	ECO#
5/2/13	Created 18294
7-8-13	19630

PART: 105753
 DWG: 105753

Project: WIRING DIAGRAM
 Application: LOGIC CONTROLLER
 Supplier:

PINK SHEET



1-800-729-3839

Factory Wiring

